

Annexure C

Appendix XIII

PROFORMA FOR SAFE DRINKING WATER AND SANITARY CONDITION CERTIFICATE


Dated: 10/08/2026

No. 1076/LAB/A.E/PHE/BILASPUR

It is certified that an inspection team headed by Mr. Ashish Dongre, Chemist from PHE Department Bilaspur

Inspected the HOLY CROSS SENIOR SECONDARY SCHOOL LALKHADAN BILASPUR (CG) on 06/08/2026 checked the water. Test report is submitted by the school and found that the school has potable drinking water for students and staff of the institution and is having provision for running water in the toilets and maintaining hygienic sanitation condition in the school building & the campus as per norms prescribed by the Centre/State/UT Government.

The above certificate is valid for a period of One Year


Chemist
District Water Testing Laboratory
PHE District-Bilaspur (C.G.)
Signature with Seal
Name Mr. Ashish Dongre
Designation Chemist



District Water Testing Laboratory

Public Health Engineering Department ,
PHE. Central Store Campus, behind Civil Police Station, Bilaspur (C.G.)
Contact as email – bspghedlab@gmail.com

Test Report

Discipline- Chemical Testing	Group- Drinking water	Report no.1490	ULR NO. :- TC155022600001490F	
Senders name & address	Senders letter no./Date	06.08.2026	Sampled by	Kajmir Kujur
Principal, Holy Cross Senior Secondary School, Lalkhadan Bilaspur (c.g.)	DL receipt no.	1490	DL Receipt date	06.08.2026
	Date of analysis started	06.08.2026	Date of analysis completed	10.08.2026


Sample Details:-

Sr. no.	Sample I.D.	District /Block	City / Village	Location/source no./GPS identification	Condition of Sample
1	08/26/1490/7701	Bilaspur	Bilaspur	Holy Cross Senior Secondary School, Lalkhadan	OK

Details of parameters their test method units and specification as per IS/APHA :-

S.n.	Parameters	Test method IS:3025/APHA 24 th ed.		Unit	As per IS- 10500-2012 drinking water		Result			
		Method	Part no.		Desira ble Limit	Permi ssible Limit	1	2	3	4
1	2	3	4	5	6	7	8	9	10	11
1	Turbidity	APHA (24 th Ed)	Part-10	NTU	1	5	1.98	-	-	-
2	Color	APHA (24 th Ed)	Part-2120B	CU	5	15	5.0	-	-	-
3	Odour	IS:3025	Part-05	-	Agr	Agr	Agreeable	-	-	-
4	Taste	IS:3025	Part-7/8	-	Agr	Agr	-	-	-	-
5	PH @ 25°C	APHA (24 th Ed)	Part-11	PH scale	6.5-8.5	6.5-8.5	7.42	-	-	-
6	Total Alkalinity as CaCO ₃	APHA (24 th Ed)	Part-2320 B	mg/l.	200	600	358.43	-	-	-
7	TDS	APHA (24 th Ed)	Part-3540-C	mg/l.	500	2000	764	-	-	-
8	Chloride as Cl ⁻	APHA (24 th Ed)	Part- 4500-Cl- B	mg/l.	250	1000	152.46	-	-	-
9	Total Hardness as CaCO ₃	APHA (24 th Ed)	Part-2340-C	mg/l.	200	600	486.09	-	-	-
10	Calcium as Ca ⁺⁺	APHA (24 th Ed)	Part-3500-Ca- B	mg/l.	75	200	118.4	-	-	-
11	Magnesium as Mg ⁺⁺	APHA (24 th Ed)	3500-Mg-B	mg/l.	30	100	49.32	-	-	-

- 1 The report should not be produced partly or full without approval signatory authority of legal purpose.
- 2 The results refer only to tested samples and parameters.
- 3 This Lab does not hold any responsibility for verification in results for samples kept on hold for wants of clarification.
- 4 Samples will be stored for a period of 10 days from date of issue of report.
- 5 Abbreviation Symbolize as Agr=Agreeable, Disagr=Disagreeable

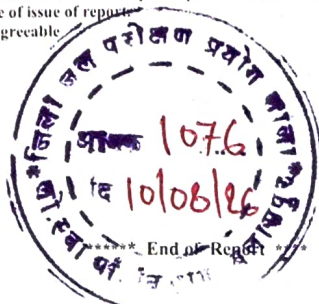

Report Reviewed & Approved By

Ashish Dongre
Authorised Signatory



District Water Testing Laboratory
Public Health Engineering Department,
PHE. Central Store Campus, behind Civil Police Station, Bilaspur (C.G.)
Contact as email – bspshedlab@gmail.com



Test Report

Discipline- Chemical Testing	Group- Drinking water	Report no. 1490		
Senders name & address :- Principal, Holy Cross Senior Secondary School, Lalkhadan Bilaspur (c.g.)	Senders letter no./Date	06.08.2026	Sampled by	Kajmir Kujur
	DL receipt no.	1490	DL Receipt date	06.08.2026
	Date of analysis started	06.08.2026	Date of analysis completed	10.08.2026


Sample Details:-

Sr. no.	Sample I.D.	District /Block	City / Village	Location/source no./GPS identification	Condition of Sample
1	08/26/1490/7701	Bilaspur	Bilaspur	Holy Cross Senior Secondary School, Lalkhadan	OK

Details of parameters their test method units and specification as per IS/APHA :-

s.n.	Parameters	Test method IS:3025/APHA 24th ed.		Unit	As per IS-10500-2012(second-revision) drinking water		Results				
		Method	Part no.		Desirable Limit	Permissible Limit	1	2	3	4	5
1	2	3	4	5	6	7	8	9	10	11	12
1	Spe. Conductivity @ 25 °C	IS:3025	Part-14	µS/cm	-	-	1232.26	-	-	-	-
2	Nitrate as NO ₃	APHA (24 th Ed)	Part-2120B	Mg/l	45	45	-	-	-	-	-
3	Iron as Fe ⁺⁺	APHA (24 th Ed)	Part-05	Mg/l	0.1	0.3	0.12	-	-	-	-
4	Fluoride as F ⁻	APHA (24 th Ed)	Part-7/8	Mg/l	1.0	1.5	0.26	-	-	-	-
5	Residual Chlorine	-	-	Mg/l	0.2	Nil	-	-	-	-	-
6	Sulphate	IS:3025	Part-24	Mg/l	200	400	-	-	-	-	-
7	Total Coliform	APHA (24 th Ed)	Part-9222B	CFU / 100 ML	Nil	Nil	Nil	-	-	-	-
8	Thermotolerant Coliform	APHA (24 th Ed)	Part-9222D	CFU / 100 ML	Nil	Nil	Nil	-	-	-	-

- The report should not be produced partly or full without approval signatory authority of legal purpose.
- It is recommended that acceptable limit is to be implemented. Values in excess of those mentioned under "acceptable" render the water not suitable, but still may be tolerated in the absence of an alternative source but up to the limits indicated under the "permissible" limit in the absence of alternate source in column 7 above which the sources will have to be rejected.
- The results refer only to tested samples and parameters.
- This Lab does not hold any responsibility for verification in results for samples kept on hold for wants of clarification.
- Samples will be stored for a period of 10 days from date of issue of report.

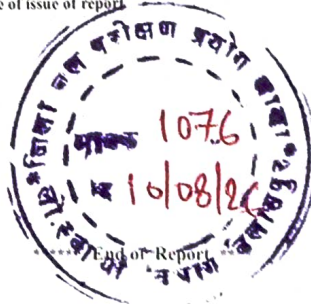

Chemist
District Water Testing Laboratory
PHED Bilaspur (C.G.)